


EnduraStone® FRP Columns with Flame Guard set a new industry standard:		
	Flame Spread Index (FSI)	Smoke Developed Index (SDI)
Industry-Standard for FRP Columns	70-85	900-1025
Endura-Stone® Columns	15*	335**

*Class I Flame-Spread classification under 1997 uniform fire code.
 **Well below the allowable SDI index of 450.

TUSCAN BASE					TUSCAN CAPITAL			
Plinth	Torus		Total Height		Echinus	Abacus		Total Height
A	B	C	D	B-D	E	F	G	E-F
16- 1/4"	2- 3/4"	2- 3/4"	7 1/2"	6"	1- 3/4"	2"	14- 1/2"	3- 3/8"


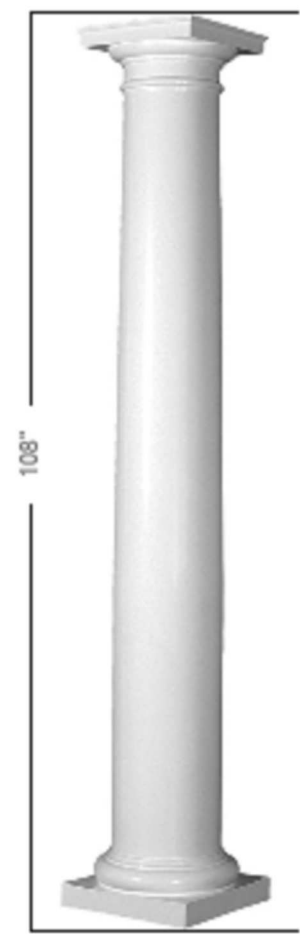


COLUMN SPECIFICATIONS					
Plan Type R ¹	Column Height	Trimming from bottom of shaft ²		Load Bearing Capacity ³	
Split in 1/2 for Reassembly	w/o Interfering w/Taper	w/o Interfering w/Panels			
○	108"	44- 3/4"	38- 1/4"	108"	102"
0 lbs.					


SHAFT SPECIFICATIONS					
Shaft Bottom			Shaft Top		
Outside	Inside	Outside	Inside	Astragal	Neck Height
C*	D**	H*	I**	F	G
12"	10- 1/4"	10"	9- 1/4"	1/4"	5"

*Actual outside diameters are approximately 5/16" to 1/2" less than shown
 **Actual inside diameters may vary by 3/8"

OTHER INFORMATION					
Material ⁴		Wraps Post Size ⁵		Weight	
Shaft	Capital Base	Round (Fits up to)	Square (Fits up to)	Shaft	Capital Base Total
FRP	Urethane FRP	8- 7/8"	6"	115.00 lbs.	2.40 lbs. 8.50 lbs. 125.9 lbs.

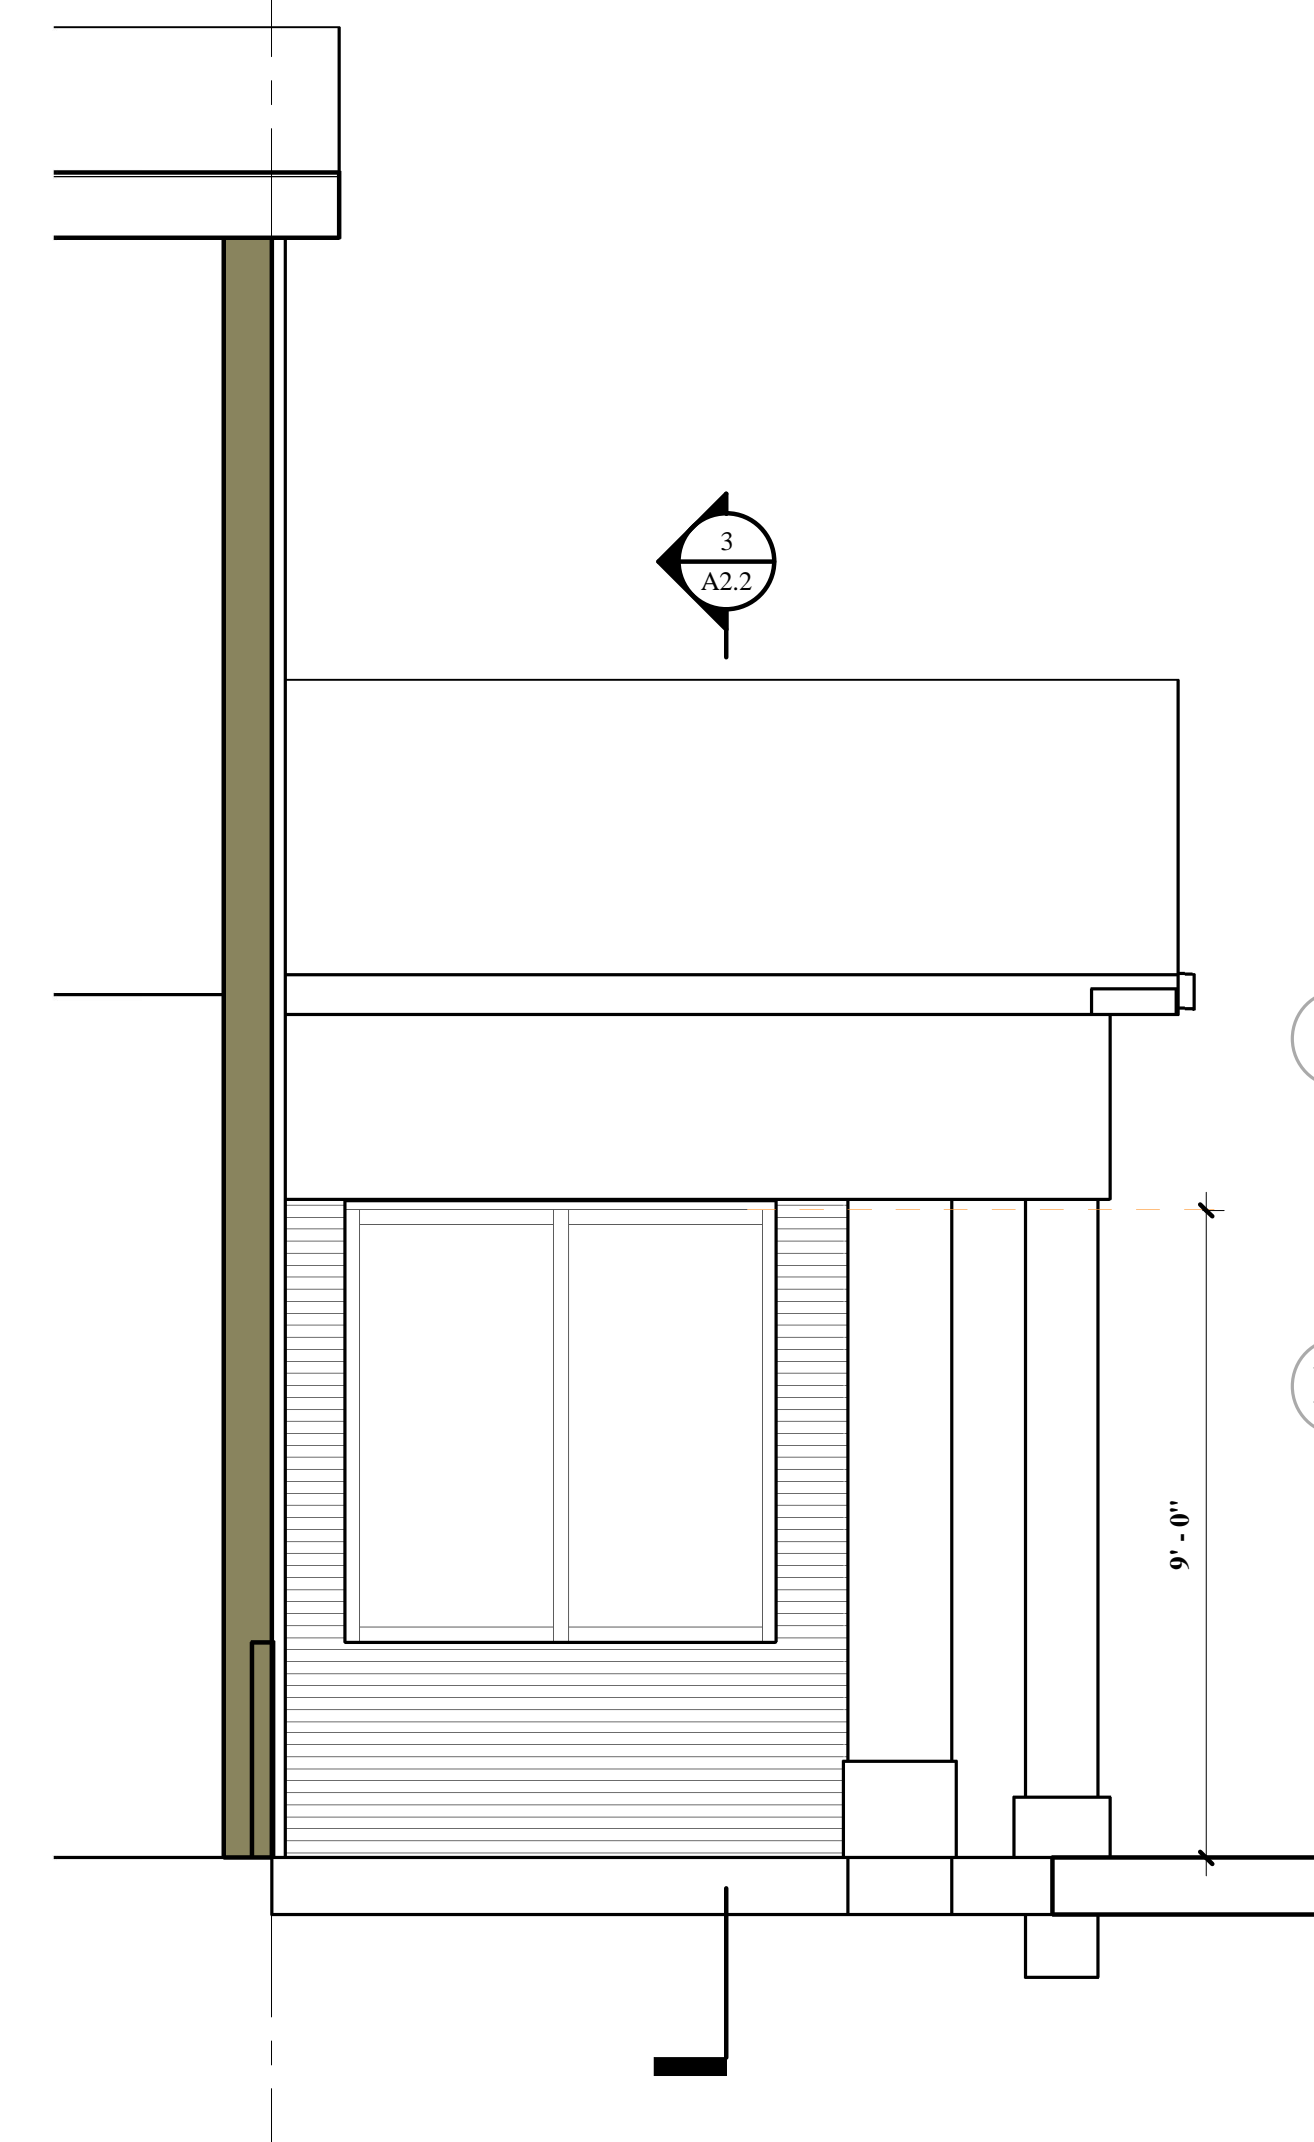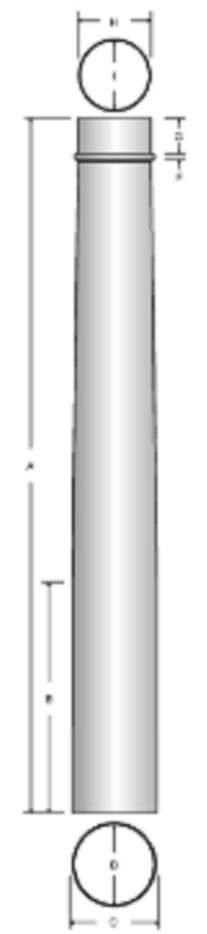


5 ENTRY SECTION 3
 3/8" = 1'-0"

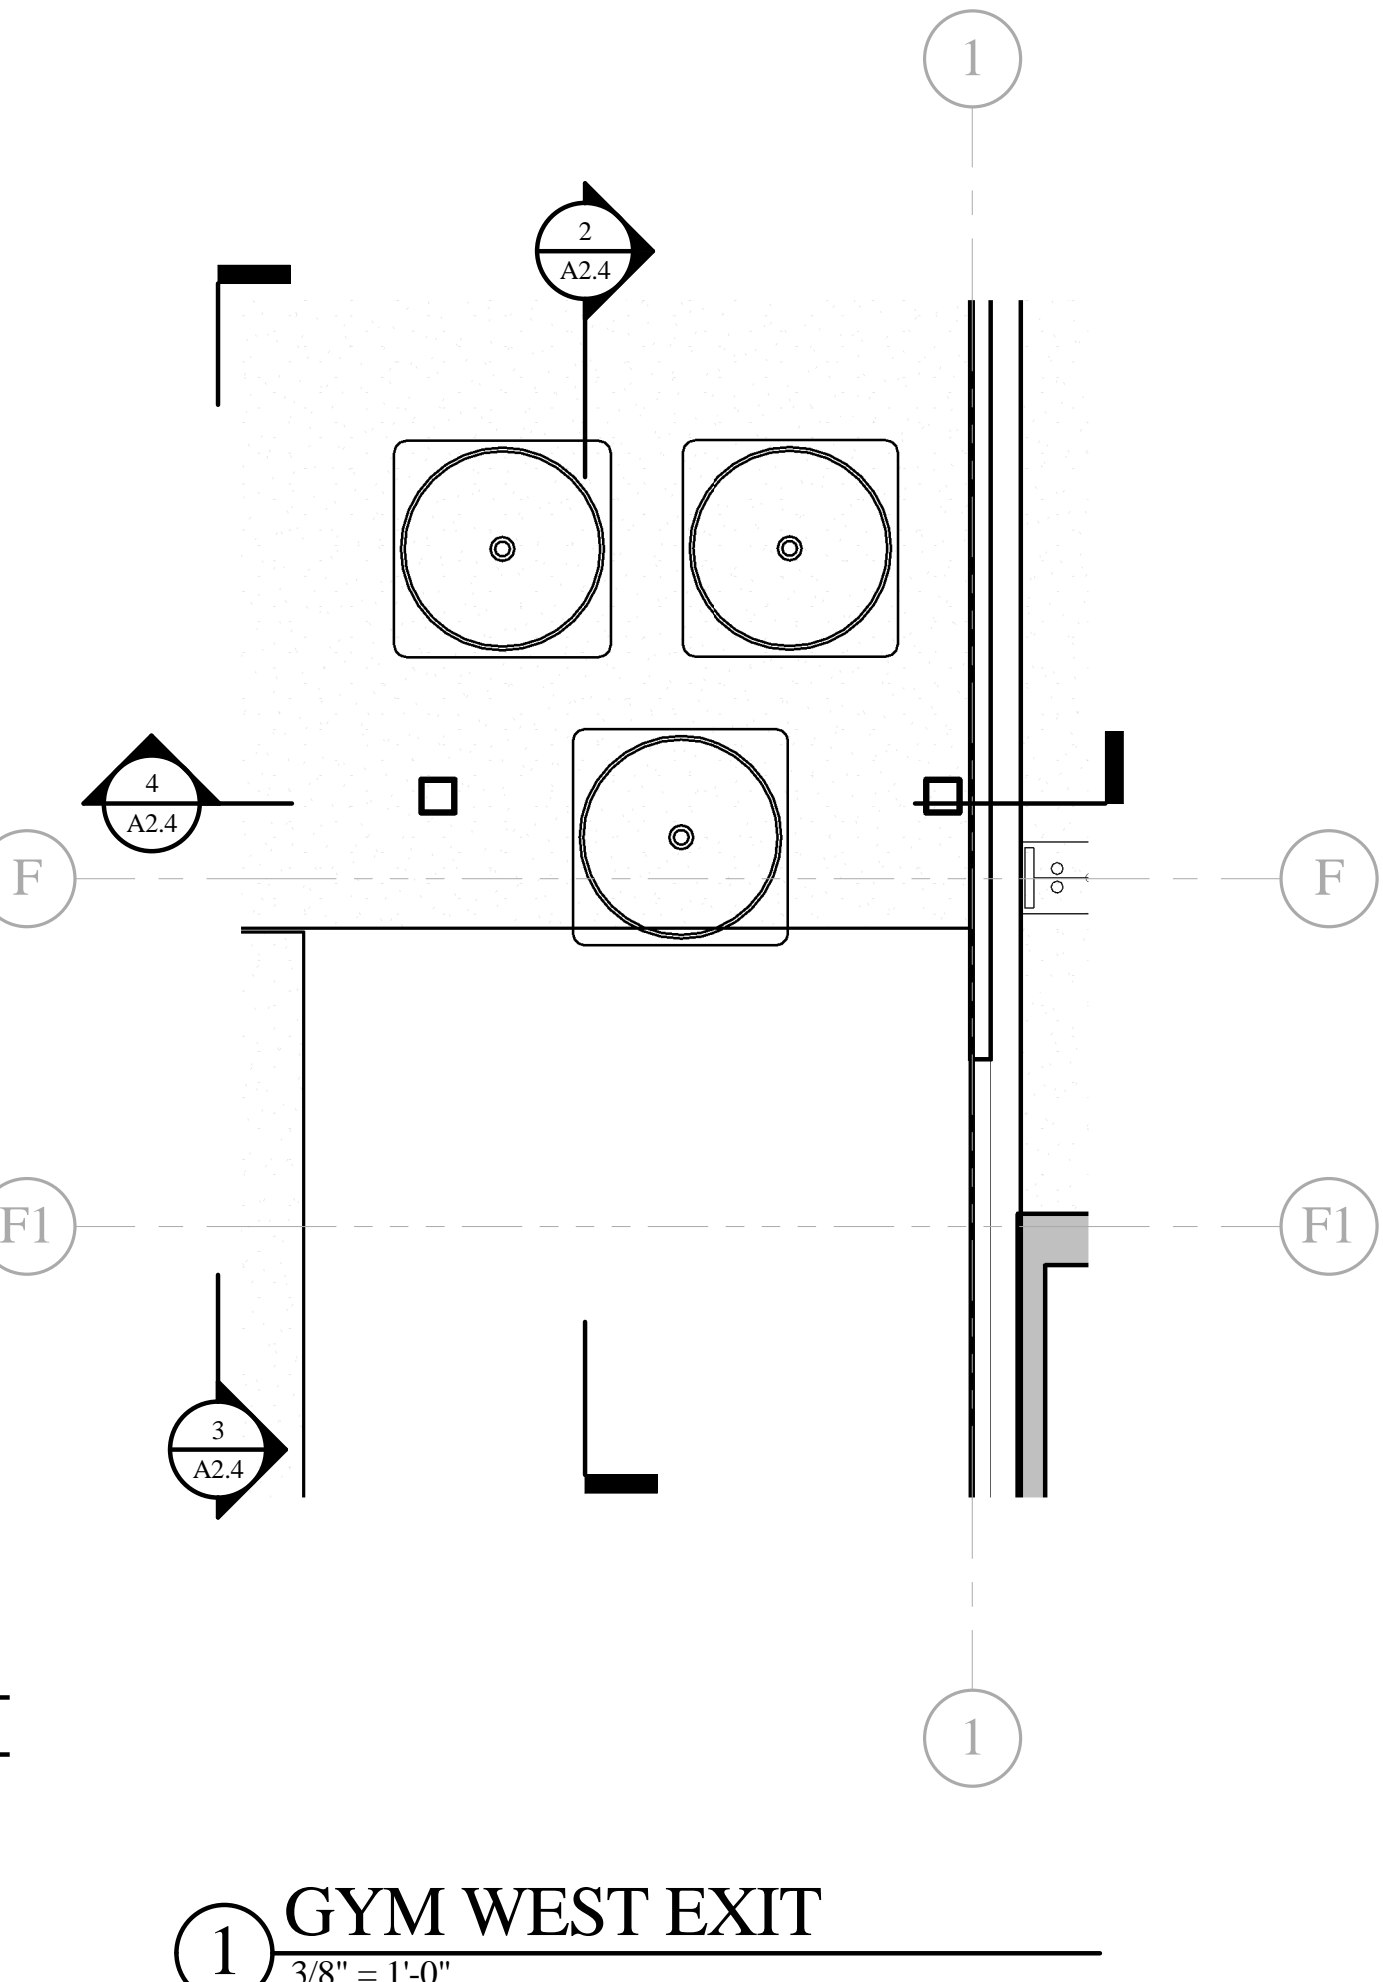


1 GYM WEST EXIT
 3/8" = 1'-0"


6 COLUMN MFG.
 1/2" = 1'-0"

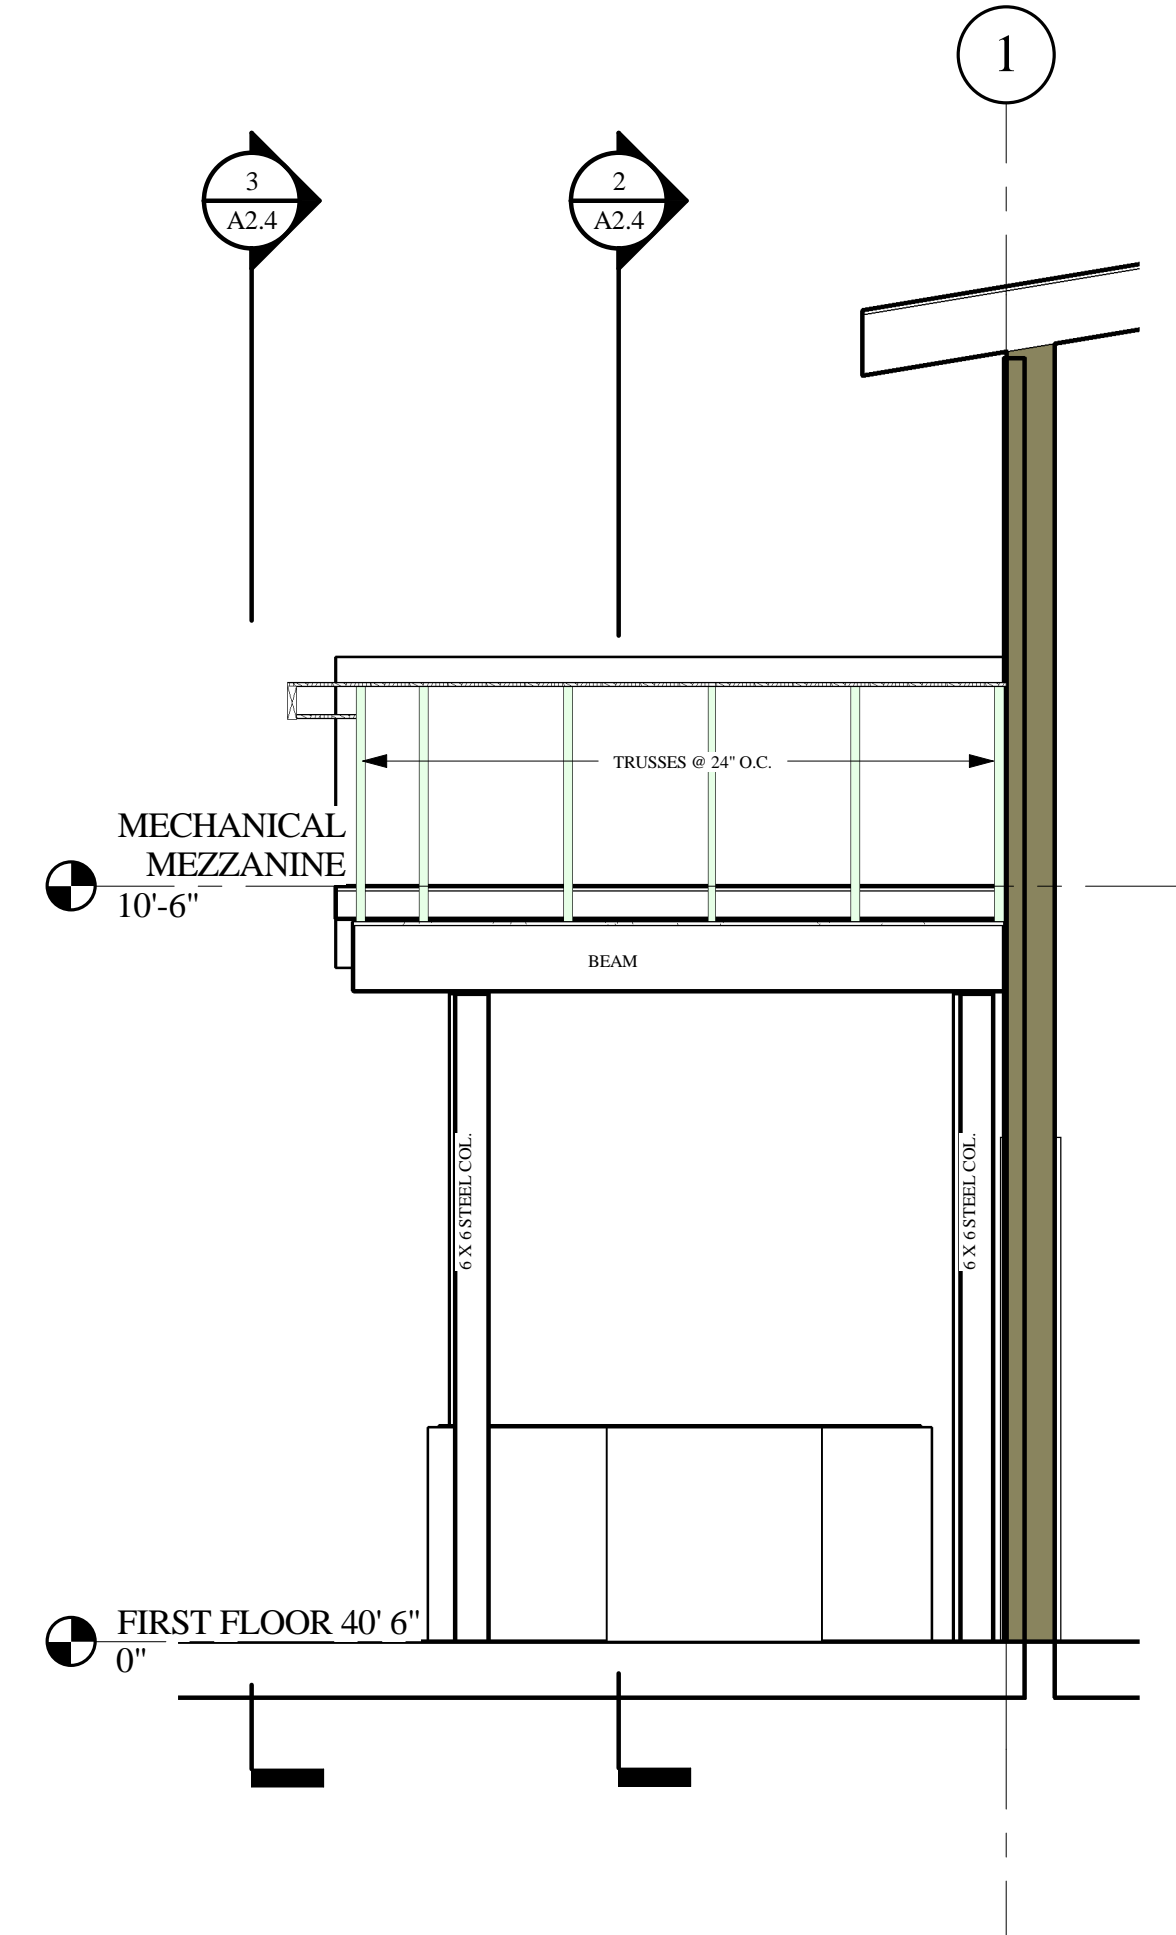

4 GYM WEST EXIT 3
 3/8" = 1'-0"

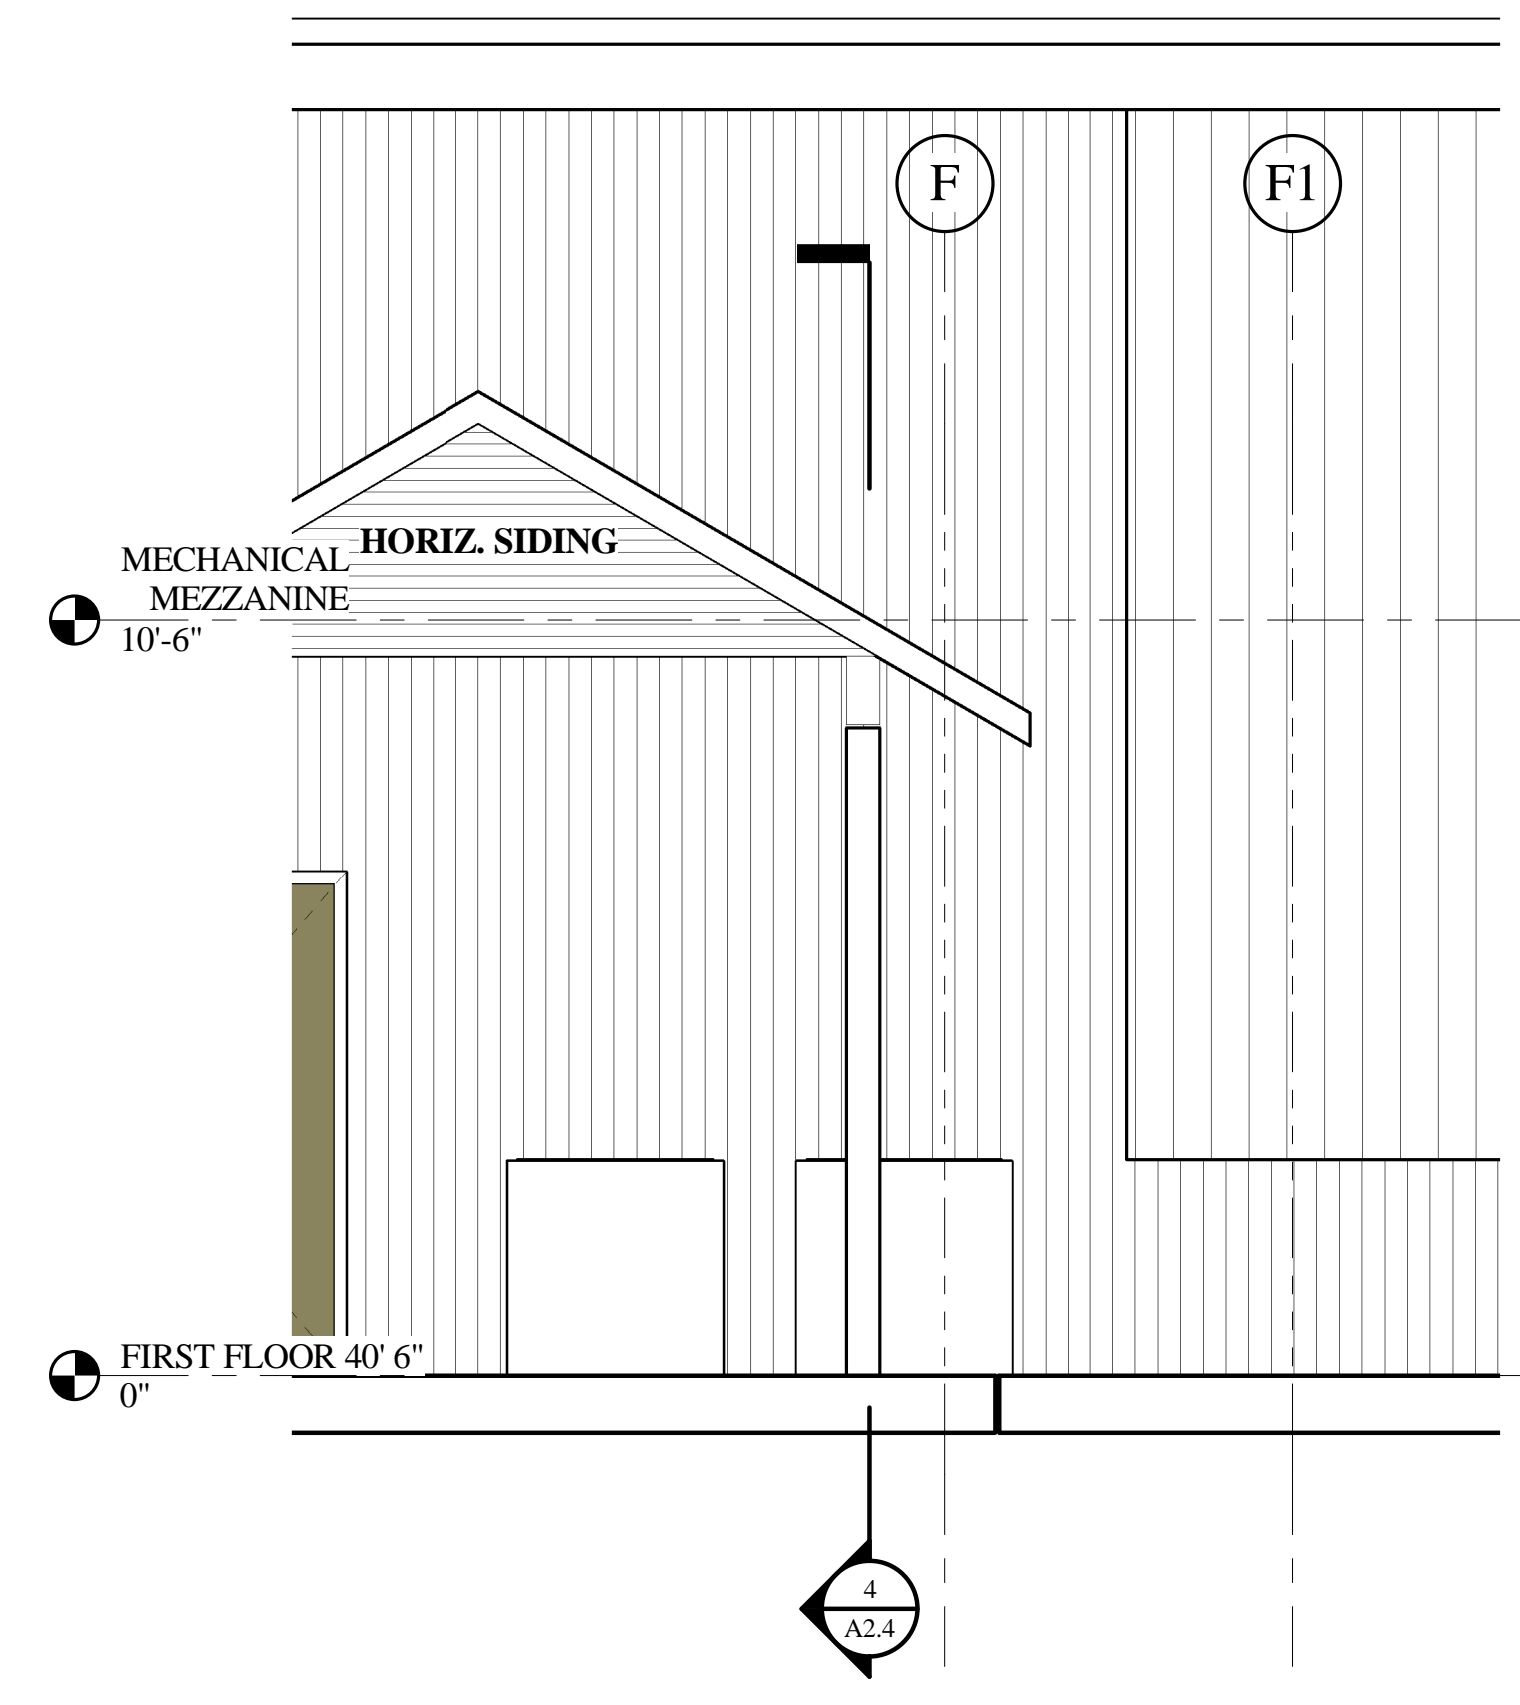

3 GYM WEST EXIT 2
 3/8" = 1'-0"

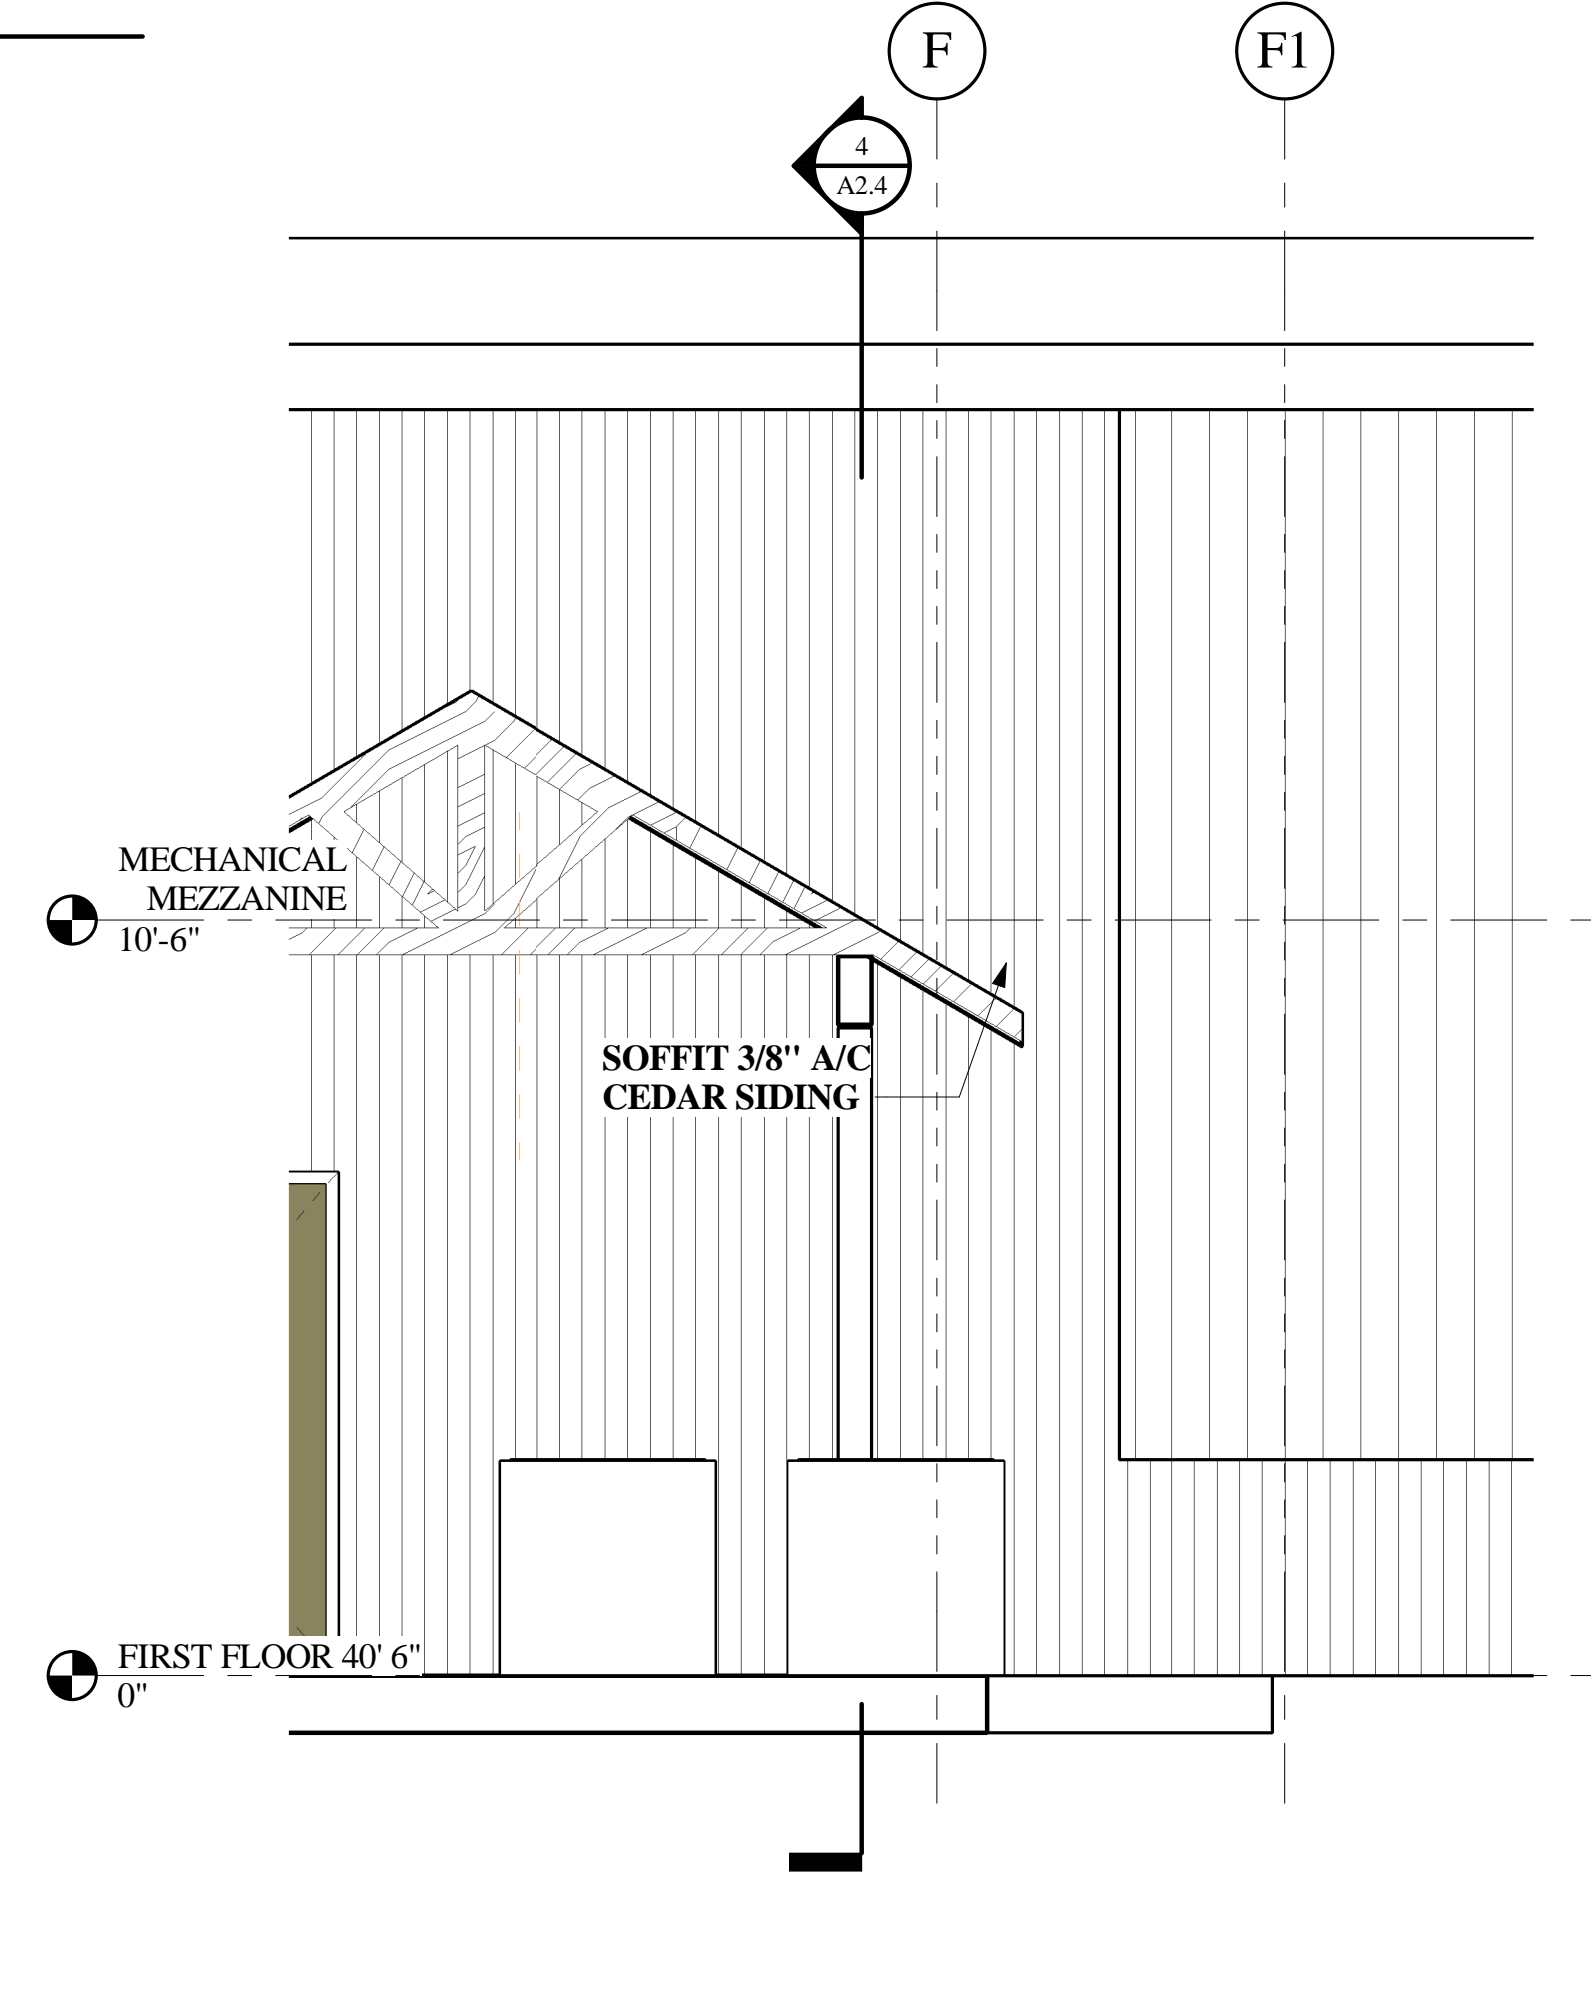

2 GYM WEST EXIT 1
 3/8" = 1'-0"

TRW Architecture Planning
 515 EAST PARKWAY CT.
 Boise, Idaho 83706
 208.371.9298
 trw@trwarchitecture.com
 www.trwarchitecture.com

LICENSED ARCHITECT
 AR 1710
 THOMAS R. WILLIAMS
 8-7-2018
 STATE OF IDAHO

ADAMS COUNTY COMMUNITY CENTER
 107 MICHIGAN STREET
 COUNCIL, IDAHO

Project Number	
Date:	10/24/2018 12:01:54 PM
Drawn By:	Author
Checked By:	Checker
Revisions	

A2.4
 PLAN DETAILS